


SEC. A-A

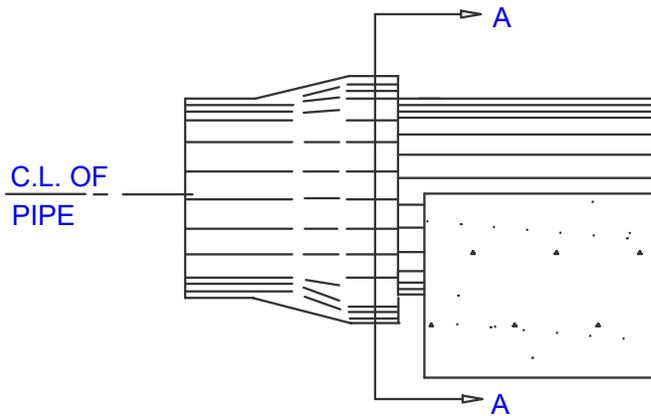

FOR USE ONLY WHERE INDICATED ON PLANS
 THE CONCRETE SHALL BE 3000 PSI CONCRETE.
 THE MINIMUM THICKNESS, ON THE SIDES AND BOTTOM
 SHALL BE 6". THE TOP OF THE CONCRETE SHALL BE
 AT LEAST TO THE CENTER OF THE PIPE.

GARDNER, KANSAS <u>PUBLIC</u> <u>WORKS/</u> <u>ENGINEERING</u> <u>DIVISION</u>	APPROVED	REVISED	CONCRETE CRADLE DETAIL	STANDARD DETAIL 30-2
	<u>JRH</u> CITY ENGINEER	_____		
	2-1-07 DATE	_____		