


<UND>Sidewalk & Sidewalk Ramp Notes:</UND>

1. Sidewalk ramp location determined from the intersection of the extension of back of sidewalk and back of curb & gutter.
2. All concrete used in this work shall meet the requirements of the City of GARDNER Technical Specifications and Design Criteria.
3. Longitudinal joint spacing to match width of sidewalk.
4. Isolation joints shall be placed where walk abuts driveways and similar structures, and 200' centers max.
5. Install 18" tie bars #4 epoxy coated @ 18" o.c.
6. Sidewalk Ramp shall be lengthened to provide ADA compliance slope but need not exceed 15'.
7. ADA maximum ramp slope = 1"/Ft.  
ADA maximum cross slope = 2%.
8. See Detectable Warning detail sheet for the installation requirements. (Detail 21-8b)

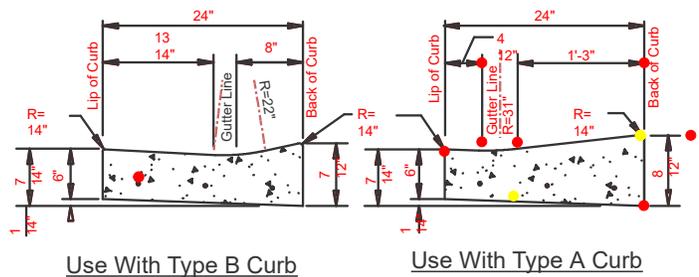

Street Curb Details at Ramp

<b>GARDNER, KANSAS PUBLIC WORKS/ ENGINEERING DIVISION</b>	<b>APPROVED</b>	<b>REVISED</b>	<b>TYPE I SIDEWALK RAMP DETAIL</b>	<b>STANDARD DETAIL 21-8</b>
	<b>JRH</b> CITY ENGINEER	<hr/>		
	<b>2-1-07</b> DATE	<hr/>		