


SECTION

NOTES
:

ALL TAPS INTO SANITARY SEWER MUST BE "CLEAN CUT" BY DRILLING OR SAWING. NO "BREAK IN" TAPS WILL BE ALLOWED.

GLUED OR CEMENTED SADDLES WILL NOT BE ALLOWED.

A MINIMUM OF 2 STAINLESS STEEL (SERIES 300 or EQUAL) STRAPS CAPABLE OF A MINIMUM OF 60 LB

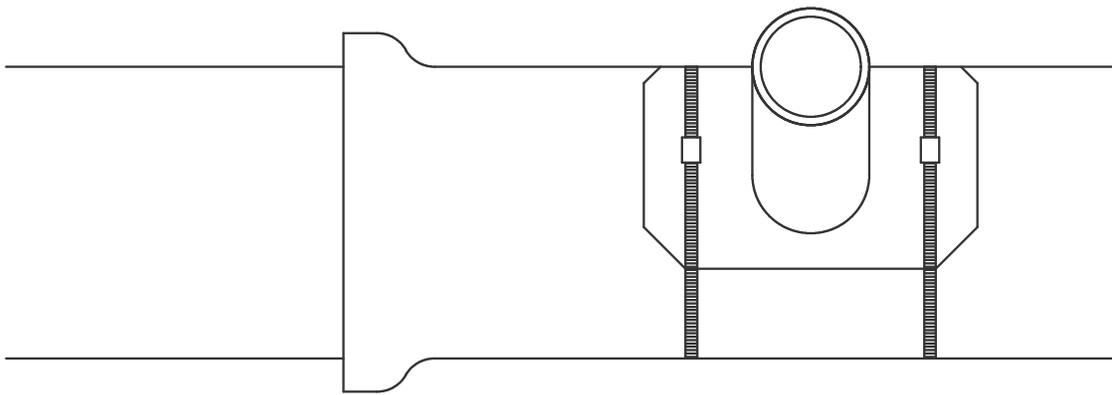

ELEVATION VIEW

GARDNER, KANSAS <u>PUBLIC</u> <u>WORKS/</u> <u>ENGINEERING</u> <u>DIVISION</u>	APPROVED	REVISED	TAPPING SADDLE DETAIL	STANDARD DETAIL 30-4
	JRH	_____		
	CITY ENGINEER	_____		
	2-1-07	_____		
	DATE			