


NOTES:

1. IF LIFTING LOOPS ARE LOCATED ON THE TOP OF THE PRECAST INLET TOPS, A MINIMUM OF 2" COVER IS REQUIRED OVER THE LIFTING LOOPS.
2. USE OF A STANDARD LID AND RING WILL BE ALLOWED WHERE GRADE PERMITS. (SEE SPEC. FOR APPROVED TYPES)
3. CONTRACTOR SHALL PROVIDE STEPS SPACED AT 1'-4" O.C. WHERE INLET OR MANHOLE DEPTH IS GREATER THAN 4'-0". STEPS SHALL BE M.A. INDUSTRIES, INC. MODEL PS-2-PF OR APPROVED EQUAL.

#5 BARS AT 6" ON CENTERS EACH WAY

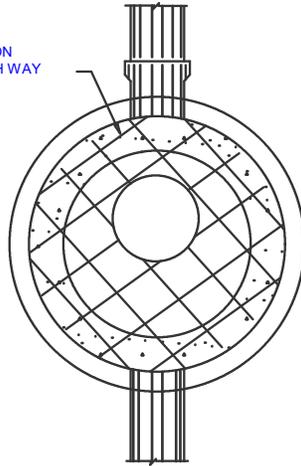


PLAN

CLAY AND BAILEY NO. 2020
DEETER NO. 2016 OR APPROVED
EQUAL. RING AND LID (CAST IN MANHOLE TOP).

DIAMETER SHALL BE AS REQ. IN STD. PRECAST MANHOLE.

COMPACTED EARTH

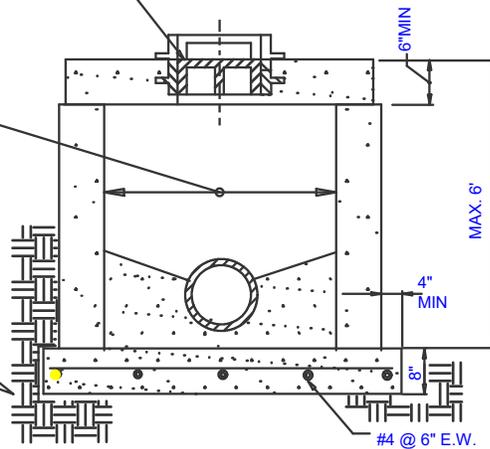

SECTION

<p>GARDNER, KANSAS PUBLIC WORKS/ ENGINEERING DIVISION</p>	<p>APPROVED</p>	<p>REVISED</p>	<p>SHALLOW JUNCTION BOX DETAIL</p>	<p>STANDARD DETAIL 40-6</p>
	<p>JRH CITY ENGINEER</p>	<p>_____</p>		
	<p>2-1-07 DATE</p>	<p>_____</p>		