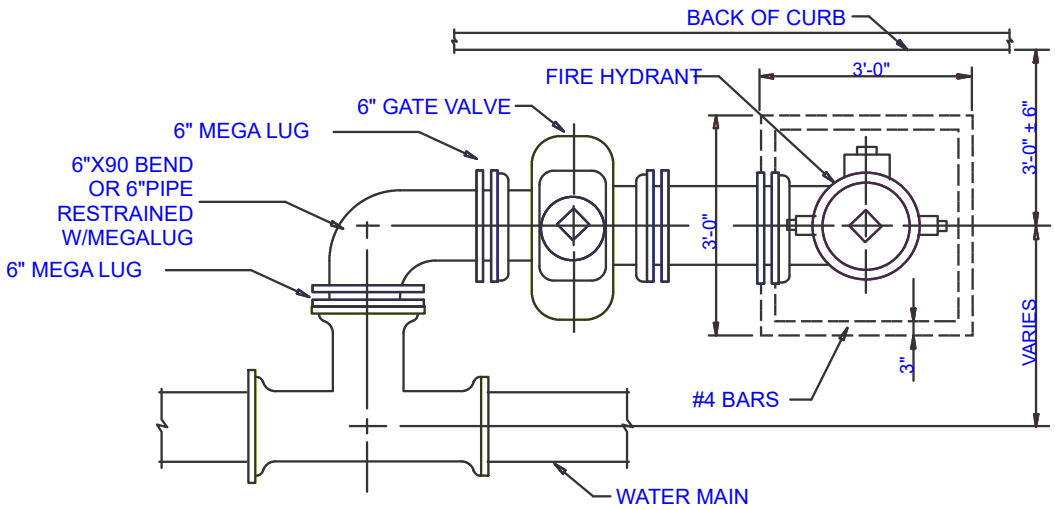

NOTE:

ALL PIPING SHALL BE RESTRAINED JOINT PIPE.

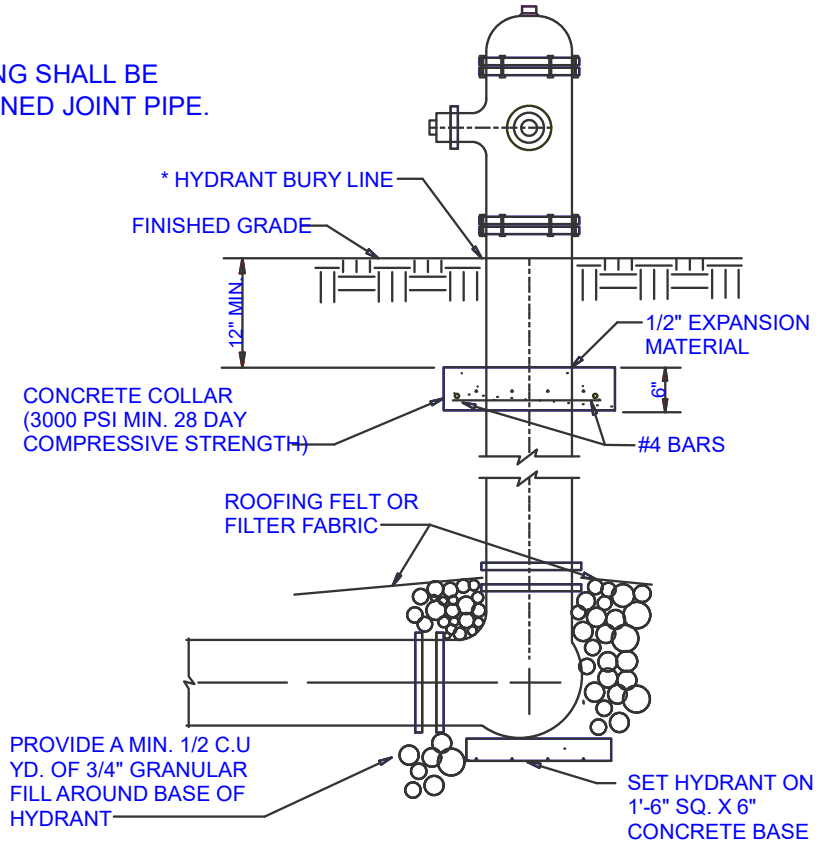

NOTE:

WHEN FIRE HYDRANT'S GATE VALVE EXCEEDS THE DISTANCE OF 5'-0" FROM CENTER OF GATE VALE TO CENTERLINE OF TEE. GATE VALVE SHALL BE ASSEMBLED TO WATER MAIN'S TEE.

GARDNER, KANSAS PUBLIC WORKS/ ENGINEERING DIVISION	APPROVED JRH ENGINEER 2-1-07 DATE	REVISED	TYPICAL FIRE HYDRANT INSTALLATION DETAIL	STANDARD DETAIL 50-2